



DRAWING REVISIONS

REV.:	BY:	DATE:	DESCRIPTION OF CHANGE	ECO NUMBER:
A	JMH	04/30/98	RECONFIGURE INTERNAL BOX LAYOUT TO ACCOMMODATE ELECTRICAL CONNECTORS	N/A

RCIR-1
EXTERNAL BOX VIEW

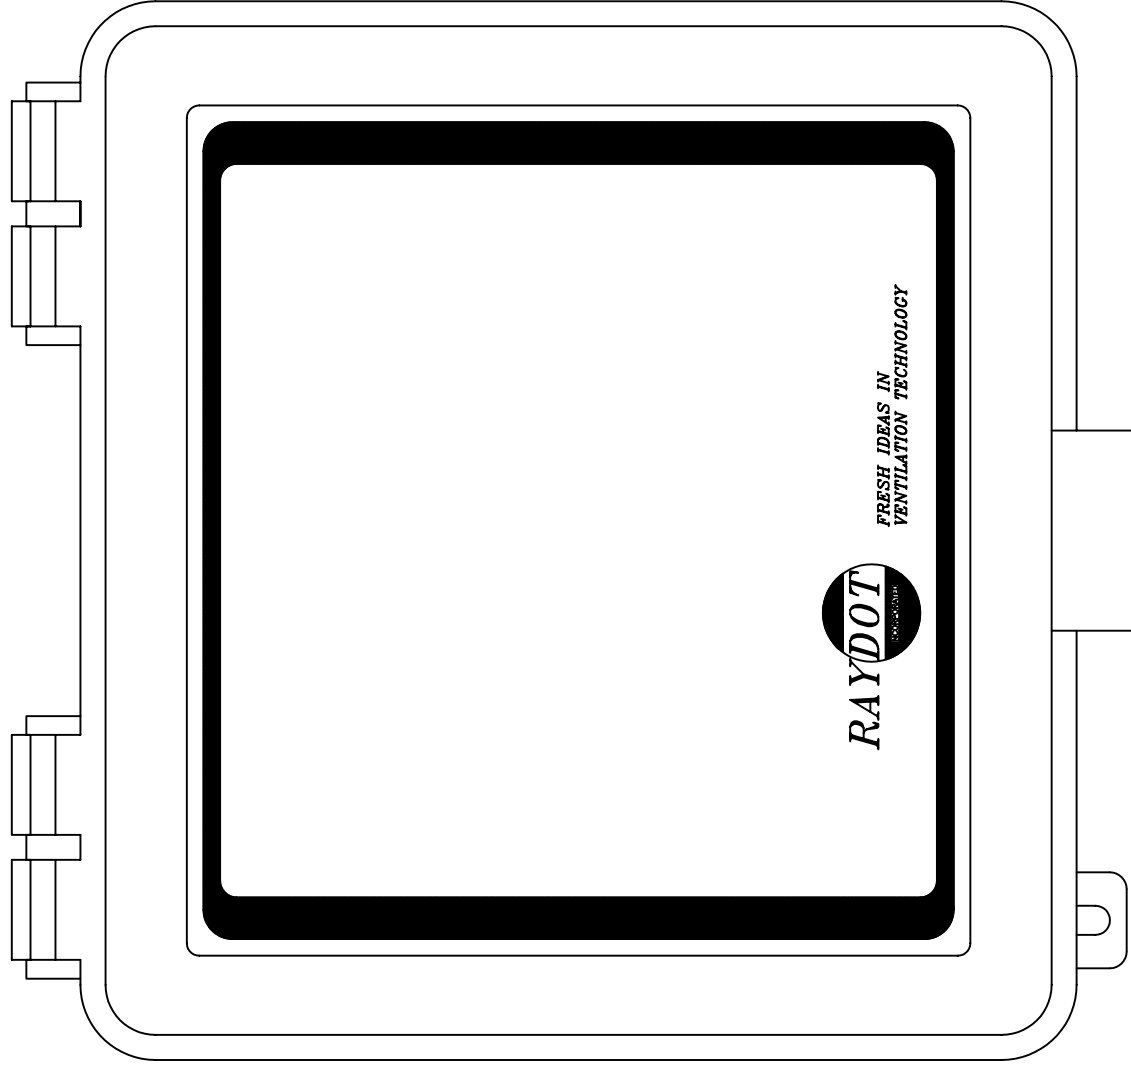

RCIR-1
INTERNAL BOX VIEW

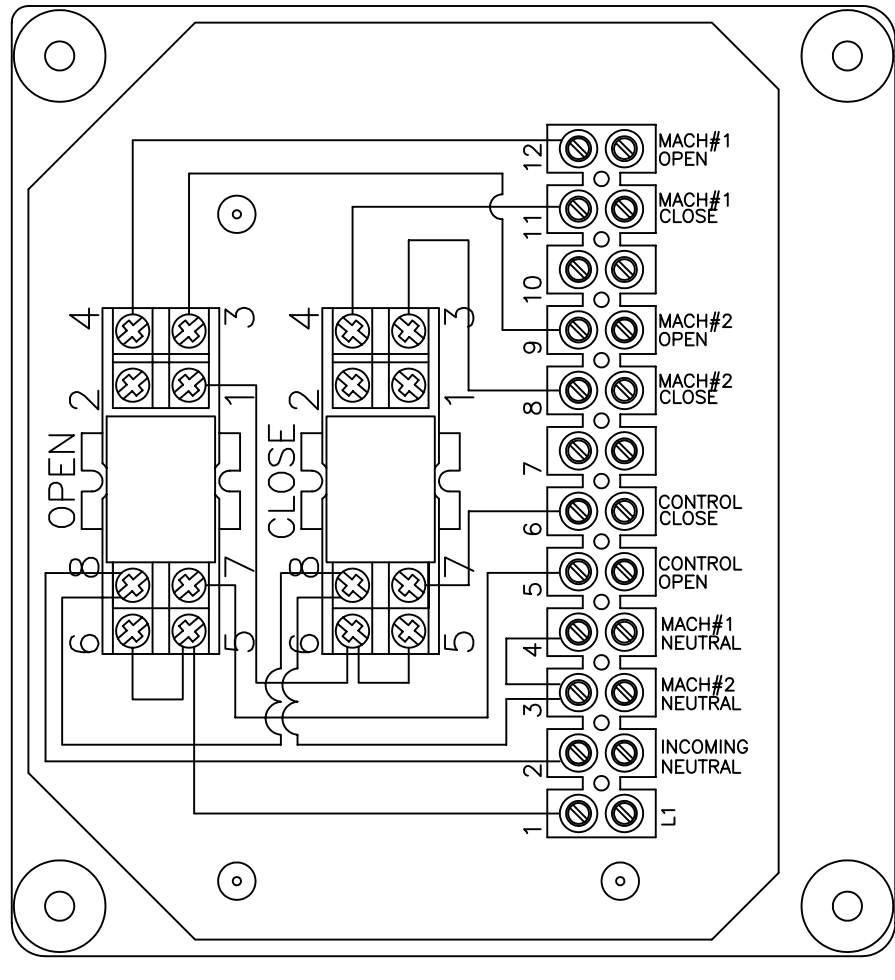

		CURTAIN ISOLATION RELAY (RCIR-1) FOR TWO - 115 VOLT CURTAIN MACHINES	
DATE: 03/13/98 DRAWN BY: JMH ENGR:	DATE: 03/13/98 DRAWN BY: JMH ENGR:	SCALE: NONE	SHEET 2 of 4
TOLERANCES UNLESS OTHERWISE SPECIFIED FRACTIONS ± 1/32 DECIMALS ± .030 INCH .X ± .020 .XX ± .010 .XXX ± .010 ANGLES ± 0°30'		BOX EXTERNAL / INTERNAL DETAILS NONE	
OLD DWG. # 15299-B-98		SCALE: NONE	