


**RD-019-131**

NOTE:  
REFER TO DRAWING  
3642-A-02 FOR LOCATION OF  
RADIANT TEMP. SENSORS.

NO. WEST NO. EAST SO. WEST  
RADIANT RADIANT RADIANT  
TEMP. TEMP. TEMP.  
SENSOR SENSOR SENSOR

RS1 RS2 RS3

COMMUNICATIONS CABLE  
TO THE VENTILATION  
CONTROL PANEL  
SENSOR WIRES TO  
THE 3 RADIANT  
HEAT SENSORS

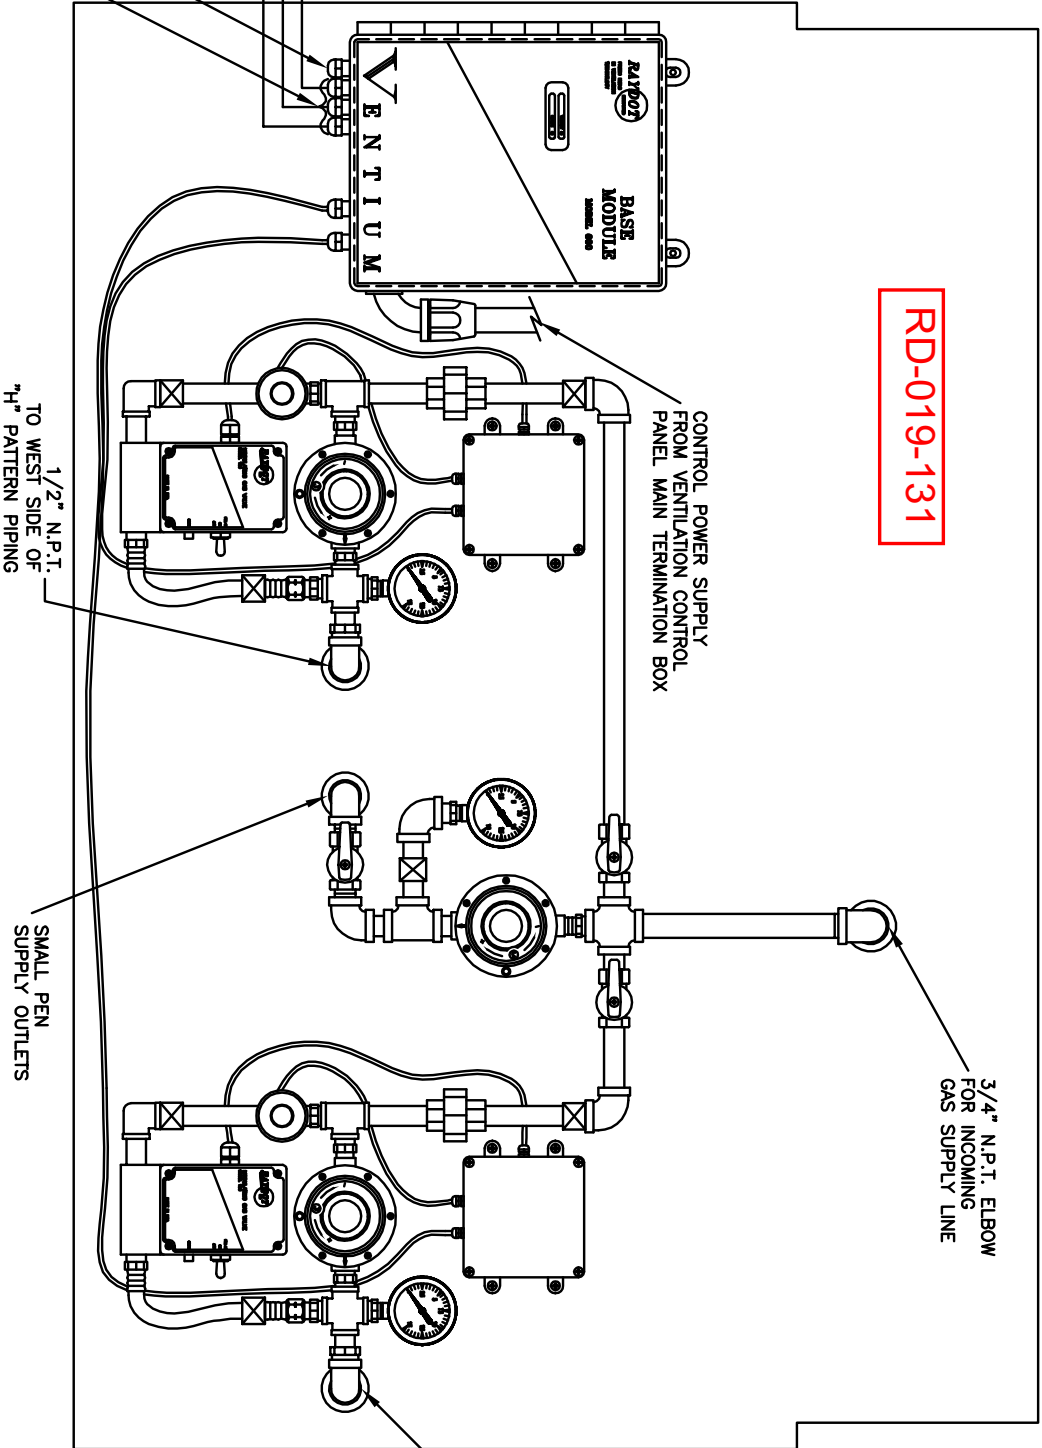

# GAS REGULATOR PANEL DETAIL

1/2" N.P.T.  
TO EAST SIDE OF  
1/4" PATTERN PIPING

1/2" N.P.T.  
TO WEST SIDE OF  
1/4" PATTERN PIPING

SMALL PEN  
SUPPLY OUTLETS

CONTROL POWER SUPPLY  
FROM VENTILATION CONTROL  
PANEL MAIN TERMINATION BOX

3/4" N.P.T. ELBOW  
FOR INCOMING  
GAS SUPPLY LINE