

## 10.2 Connection From Paltech to Hired Hand Curtain Controller

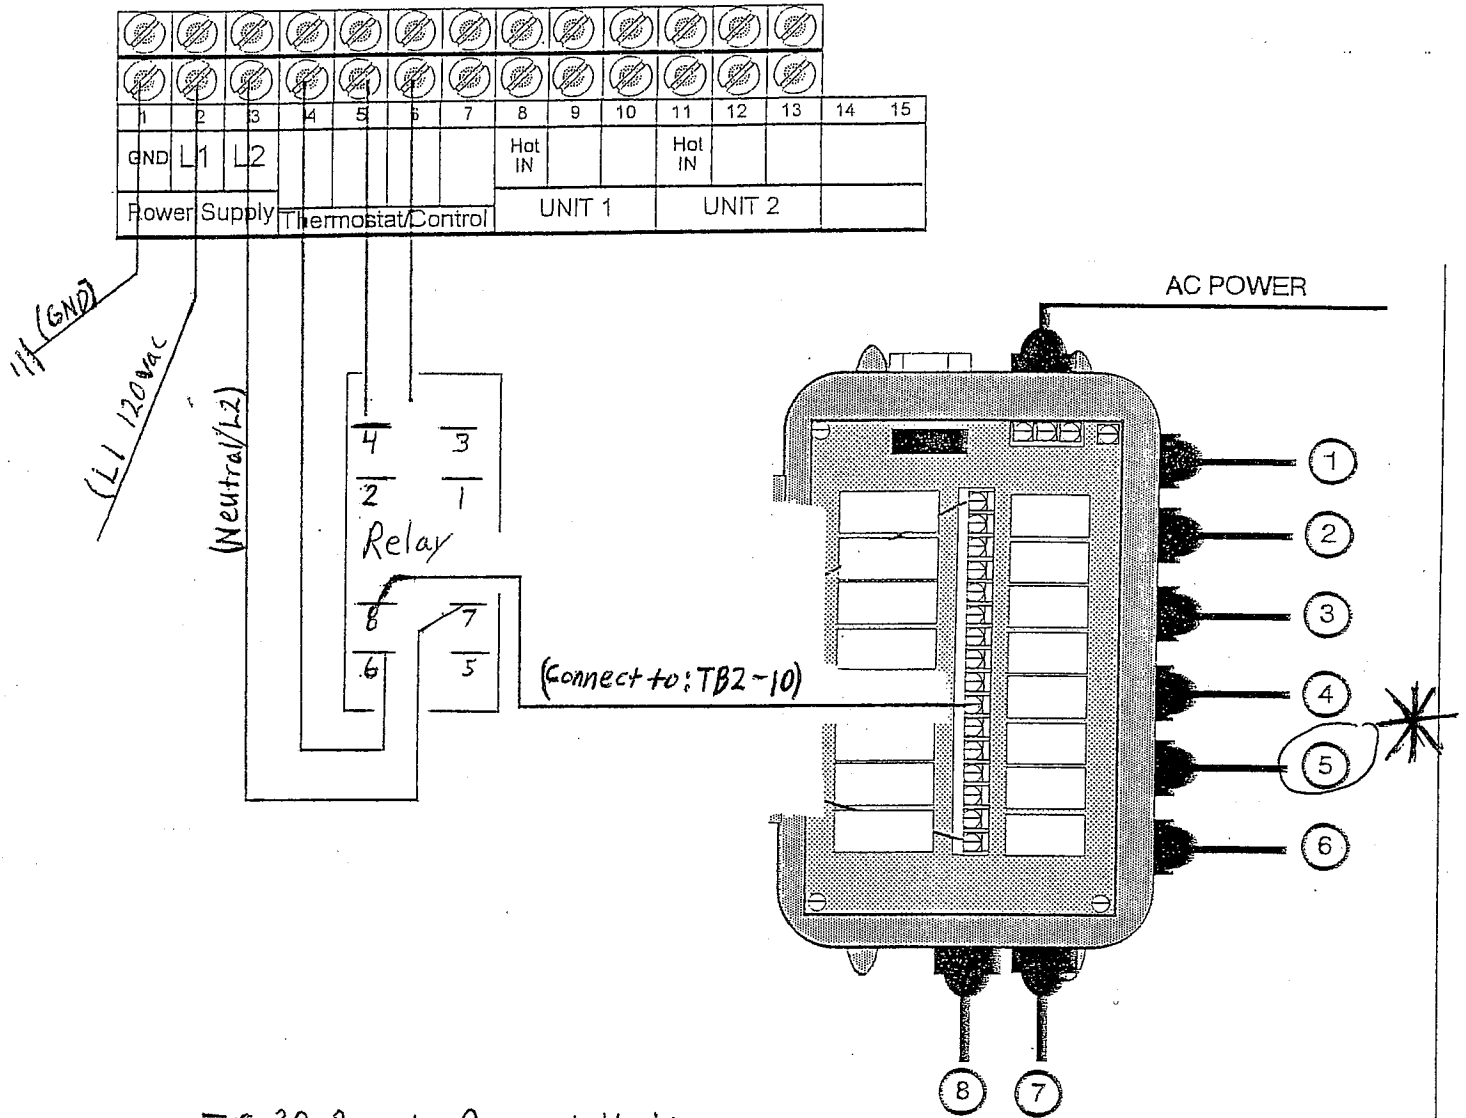


Figure 3. CABLE ROUTING DIAGRAM

TERMINAL	LINE ROUTING LOCATION	DESCRIPTION
TB2-1	1	COMMON
TB2-2	1	HI HEAT*
TB2-3	2	COMMON
TB2-4	2	LO HEAT*
TB2-5	3	COMMON
TB2-6	3	HEAT START*
TB2-7	4	COMMON
TB2-8	4	CIR FAN/FOGGER*
TB2-9	5	COMMON
TB2-10	5	SE FAN #1*
TB2-11	6	COMMON
TB2-12	6	SE FAN #2/ALARM*
TB2-13	7	COMMON
TB2-14	7	NW FAN #1*
TB2-15	8	COMMON
TB2-16	8	NW FAN #2/LIGHTS*

\* 110 VAC SWITCHED LINES