

Fig. 4—Location for installing thermostat or remote-mounted sensor.

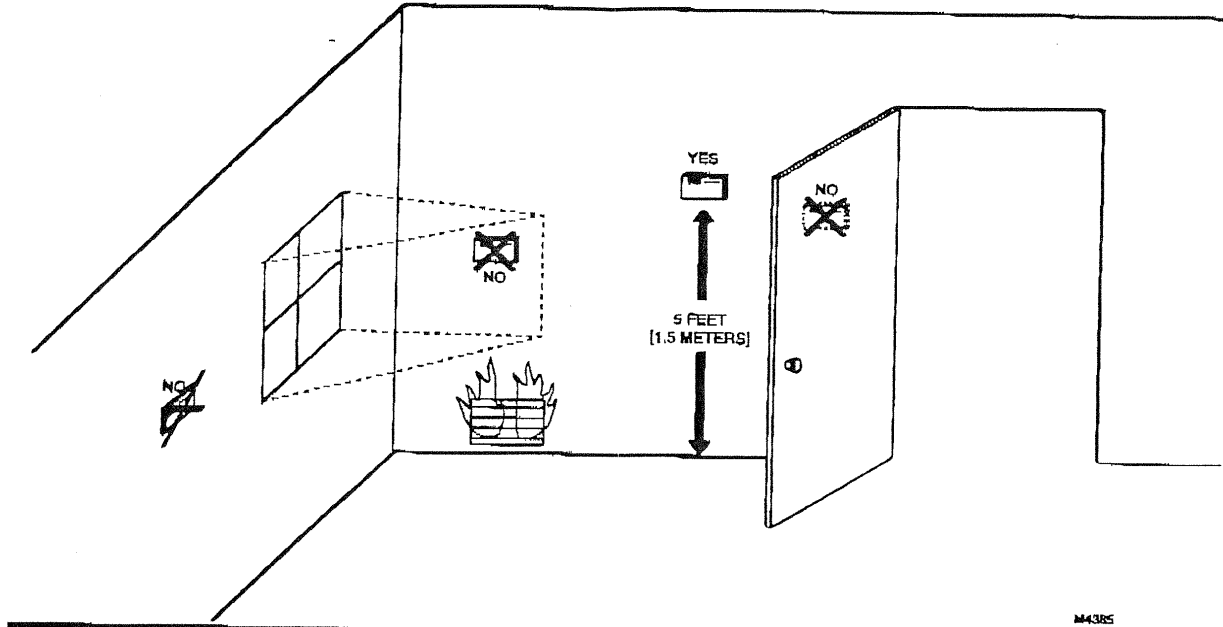


Fig. 5—Two T7047G1000 Sensors providing a temperature averaging network for a T7300/Q7300 Thermostat/Subbase.

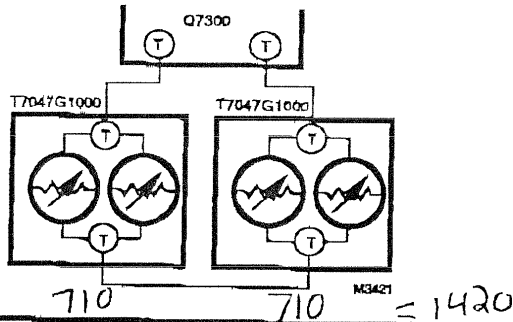


Fig. 6—Two T7047C1025 and one T7047G1000 Sensors providing a temperature averaging network for a T7300/Q7300 Thermostat/Subbase.


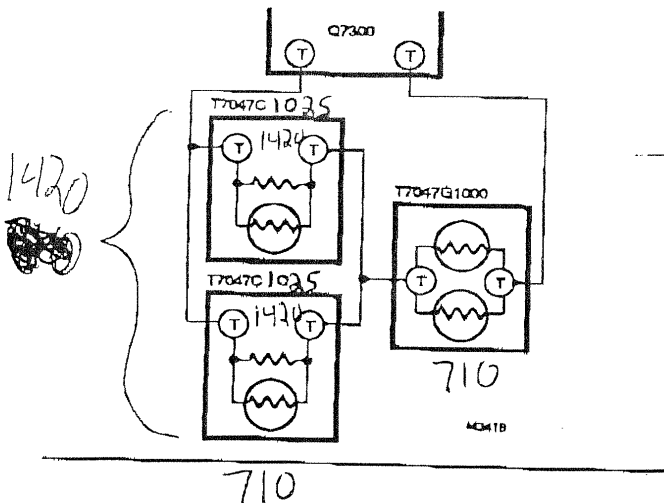


Fig. 7—Four T7047C1025 Sensors providing a temperature averaging network for a T7300/Q7300 Thermostat /Subbase.

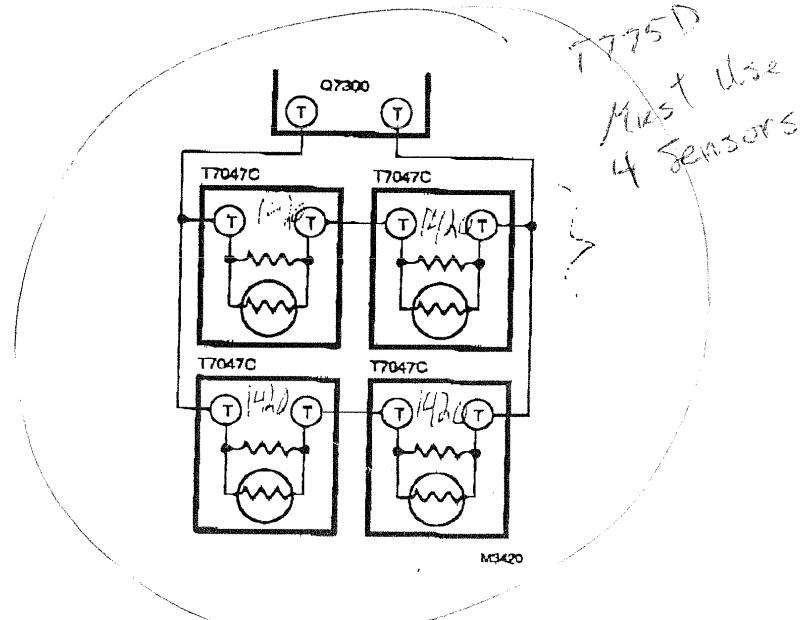

Post-it® Fax Note	7671	Date	# of pages
To	Jim H	From	
Co./Dept.		Co.	
Phone #		Phone #	
Fax #	320 286 2104	Fax #	