


NOTES

1. INSTALLATION OF A GOOD QUALITY ALARM SYSTEM IS STRONGLY ADVISED TO WARN OF POWER FAILURES.
2. PROVIDE SURGE PROTECTION (TO INCLUDE PROTECTION FROM LIGHTNING) FROM POWER SUPPLY TO UNIT. CONSULT A CERTIFIED ELECTRICIAN FOR SPECIFIC RECOMMENDATIONS.


CONNECTION FOR COMMUNICATIONS

CONNECTION FOR TOP BOARD


115/230 VAC SELECTION SWITCH




12 V BATTERY BACK-UP (NOT INCLUDED)




ALARM SUPPLY




CONTROL SUPPLY



DO NOT DRILL THIS SIDE OF THE UNIT CONTROL. USE AVAILABLE KNOCK OUTS AT THE BOTTOM OF THE UNIT.

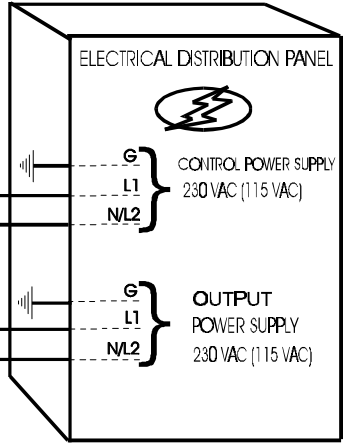

ON-OFF



OUTPUT

MAX. OUTPUT 10 AMP.

MOTOR 6 AMP.

BREAKER BOX

WIRING DIAGRAM

CS-1 TM

REV. 03